

**SUBMITTAL: FX-OPTION SCHOOL FIRE EXTINGUISHER CABINETS**

JL School Cabinets for fire extinguishers are constructed of heavy duty materials for rough duty applications. ADAC-compliant.

**Door & Trim Construction:** 12 gauge steel with white powder-coat paint finish or 14 gauge #4 stainless steel door . Flush cabinet doors are mounted in a 5/8" door stop and attached by a heavy-duty continuous hinge and equipped with a zinc-plated handle and roller catch. Door has tempered glass front and 1-1/2" face trim.

**Tub:** The double tub is constructed of 16 gauge cold rolled steel with white powder-coat finish standard. Fire-resistant material is sandwiched between the layers of steel. Heavy duty masonry anchors are welded to outside tub.

**Trim Style & Depth:** *Recessed* - 1-1/2" wide flat trim. *Semi-Recessed* - 1-1/2" square edge



CS2015F17FX

**Fire-Rating:** The recessed and semi-recessed Fire-FX™ cabinets are fabricated in accordance with the Warnock Hersey label for one and two hour combustible and non-combustible wall system building codes. The fire testing has met the requirement of the UBC standard 43-6 and ASTM-E8814-83 for membrane and penetration firestops. Installation instructions must be strictly adhered to in order to obtain the fire rating. The installation of any fire-rated cabinet which lacks a cabinet door or a condition in which the door is left ajar, will void the fire rating.

**OPTIONS AT ADDITIONAL COST:**

- (0710) Flush Cup Pull
- (PUF) Futura "Fire" Handle
- Red Powder Coat Finish
- Black Powder Coat Finish
- Red F.E. Lettering  Vertical  Horizontal
- White F.E. Lettering  Vertical  Horizontal
- Black F.E. Lettering  Vertical  Horizontal
- (D17) Horizontal Duo Panel Door with Tempered Glazing (Sub for F17)
- (V17) Vertical Duo Panel Door with Tempered Glazing (Sub for F17)
- (S21) Solid 12 Gauge Door (Sub for F17)
- (L22) Solid 12 Gauge Door with Saf-T-Lok™ (Sub for F17)
- (G17) Full Glass with Tempered Glazing & Saf-T-Lok™ (Sub for F17)
- Saf-T-Lok™ (Appears locked, but, cabinet can be opened with sharp pull)

QTY	TRIM & DOOR MATERIAL & SERIES		TUB I.D. W x H x D in Inches			FRAME O.D. W x H in Inches		WALL OPENING FIRE RATED FX OPTION			RECOMMENDED EXTINGUISHER
	STEEL	TRIM STYLE	A	B	C	E	F	W	H	D	
	CS2015F17FX	Flat Trim	12	27	7-3/4	15	30	14	29	8-3/4	Any Cosmic , Galaxy Grenadier P, Sentinel 5,10, Mercury 2-1/2,5, Any Saturn
	CS2017F17FX	1-1/2" Square Edge	12	27	7-3/4	15	30	14	29	6-1/2	

\* Weights are approximate † Grenadier P must be mounted on the back of the cabinet tub.


 <b>JL INDUSTRIES</b>	 www.activarcpg.com	Distributor:	Quantity:
		Contractor:	Approved By:
		Model #:	Architect:
		Project:	Date:
4-10-2012			




**FOR MORE INFORMATION CALL 1-888-926-1365**

Superior Specialty Supply • 9 Council Drive • PO Box 417 • Woodsboro, MD 21798 • [www.sssupply.com](http://www.sssupply.com)

**SUBMITTAL: FX-OPTION SCHOOL FIRE EXTINGUISHER CABINETS**

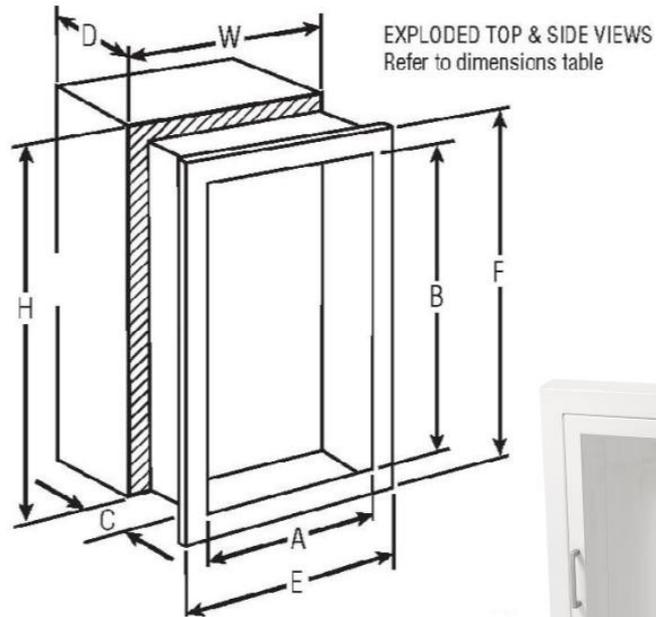

CS2017F17FX

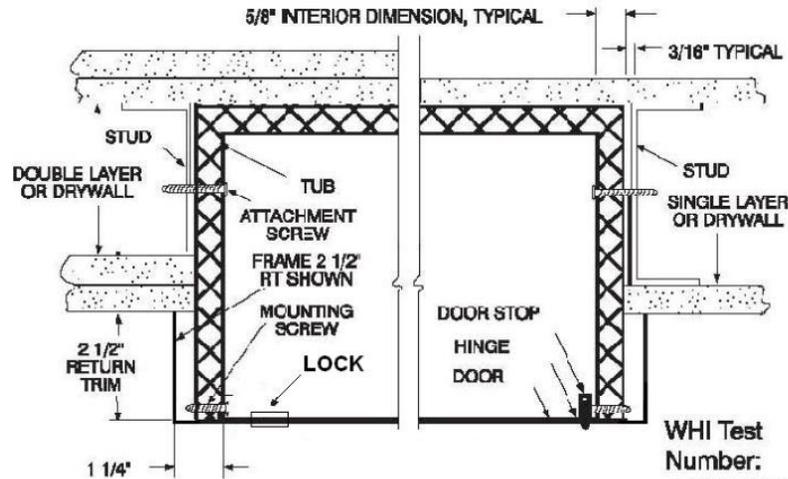

WHI Test Number:  
• 631-021201  
• 631-021202



**ACTIVAR**  
INC. www.activarcpg.com  
Construction Products Group

**FX-OPTION SCHOOL  
FIRE EXTINGUISHER CABINETS**



**FOR MORE INFORMATION CALL 1-888-926-1365**

Superior Specialty Supply • 9 Council Drive • PO Box 417 • Woodsboro, MD 21798 • [www.sssupply.com](http://www.sssupply.com)